


Midnapore 220 KV SS

Present Circuit Configuration at Vidyasagar Park, KGP WBIIDC and Midnapore

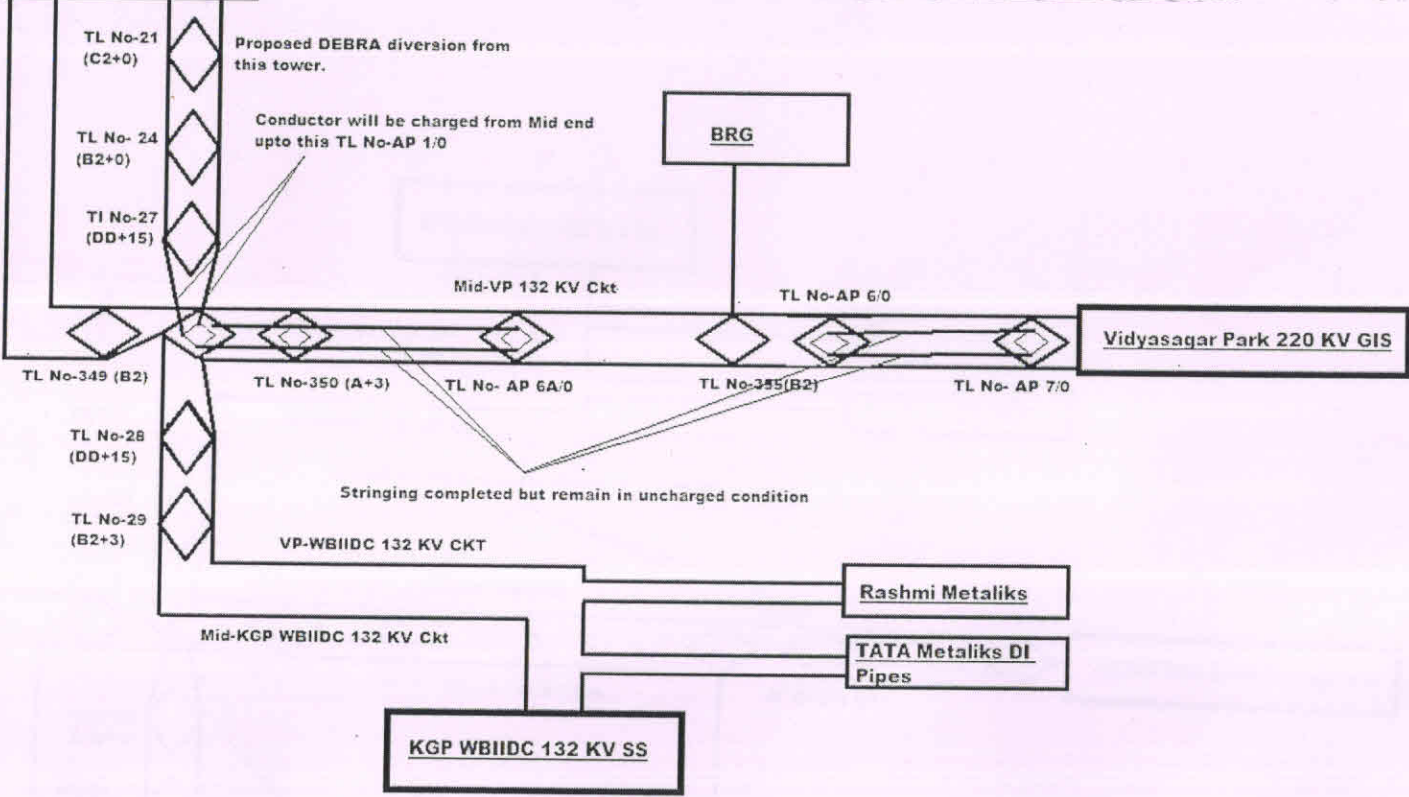

Proposed DEBRA diversion from this tower.

Conductor will be charged from Mid end upto this TL No-AP 1/0

BRG

Mid-VP 132 KV Ckt

TL No-AP 6/0

Vidyasagar Park 220 KV GIS

TL No-349 (B2)

TL No-350 (A+3)

TL No- AP 6A/0

TL No-355 (B2)

TL No- AP 7/0

TL No-28 (DD+15)

Stringing completed but remain in uncharged condition

TL No-29 (B2+3)

VP-WBIIDC 132 KV CKT

Rashmi Metaliks

Mid-KGP WBIIDC 132 KV Ckt

TATA Metaliks DI Pipes

KGP WBIIDC 132 KV SS